


### 41-B-856 HEPA Bank and Waste Hoist Tower Differential Pressure

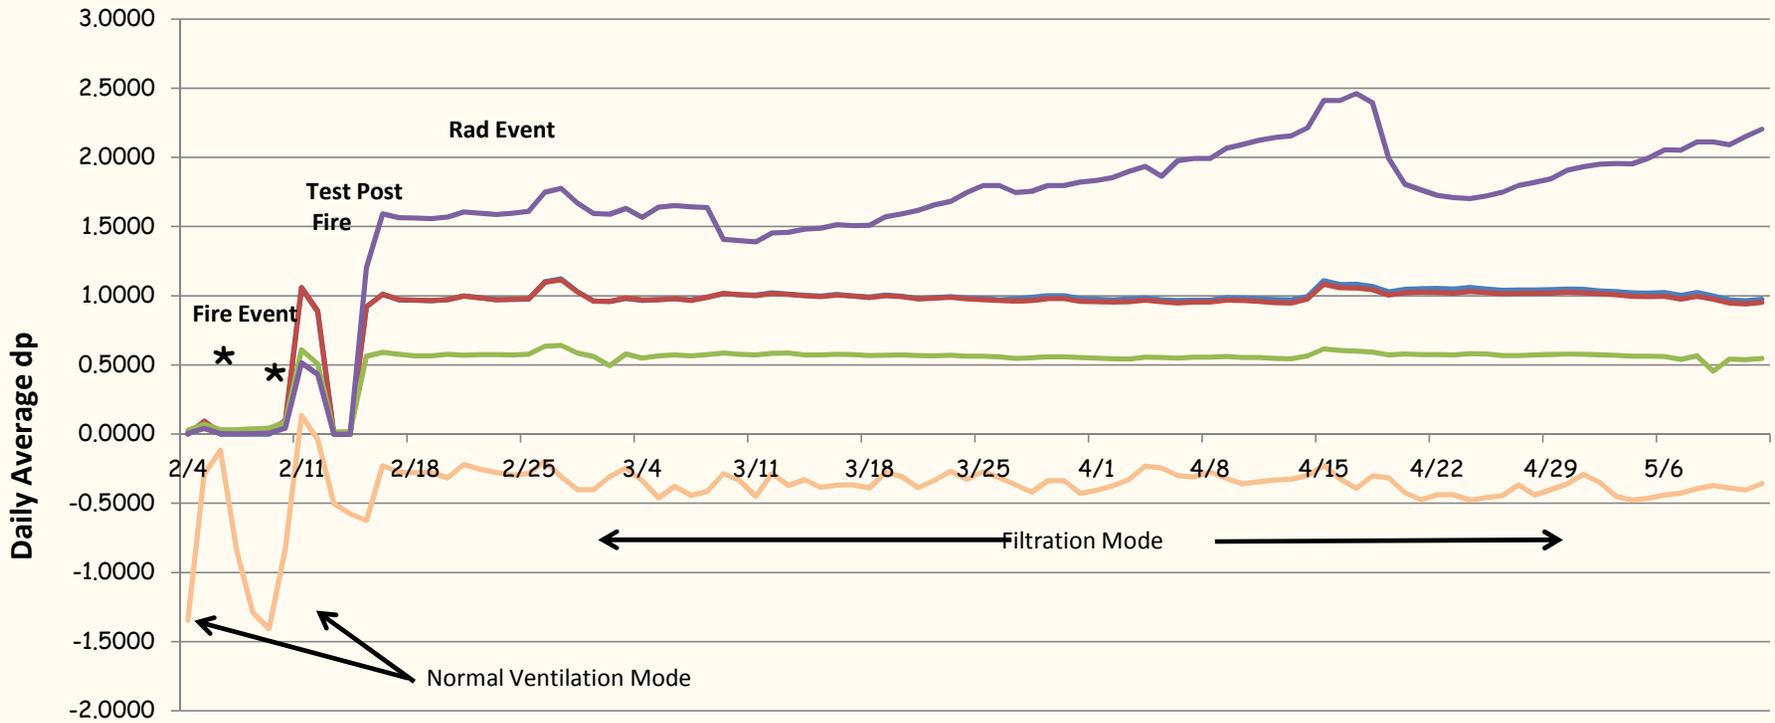


**Prior to 2/5/2014 (2/3 @ 0200-0215)**

856 Mod	0.47
856 High	0.75
856 HEPA	1.54
856 HEPA	1.45

**\* Fire Event Waste Tower dp Details**  
 During the Fire Event positive dp was seen on 2/5 and 2/6. Overall the dp was negative for the daily average.  
 2/5 Positive dp (Avg) + 0.308 (Duration 13 hrs)  
 2/6 Positive dp (AVg) + 0.200 (Duration 14 hrs)

- HEPA
- HEPA
- Hi Particulate
- Mod Filter
- WH Tower

### 41-B-857 HEPA Bank and Waste Hoist Tower Differential Pressure

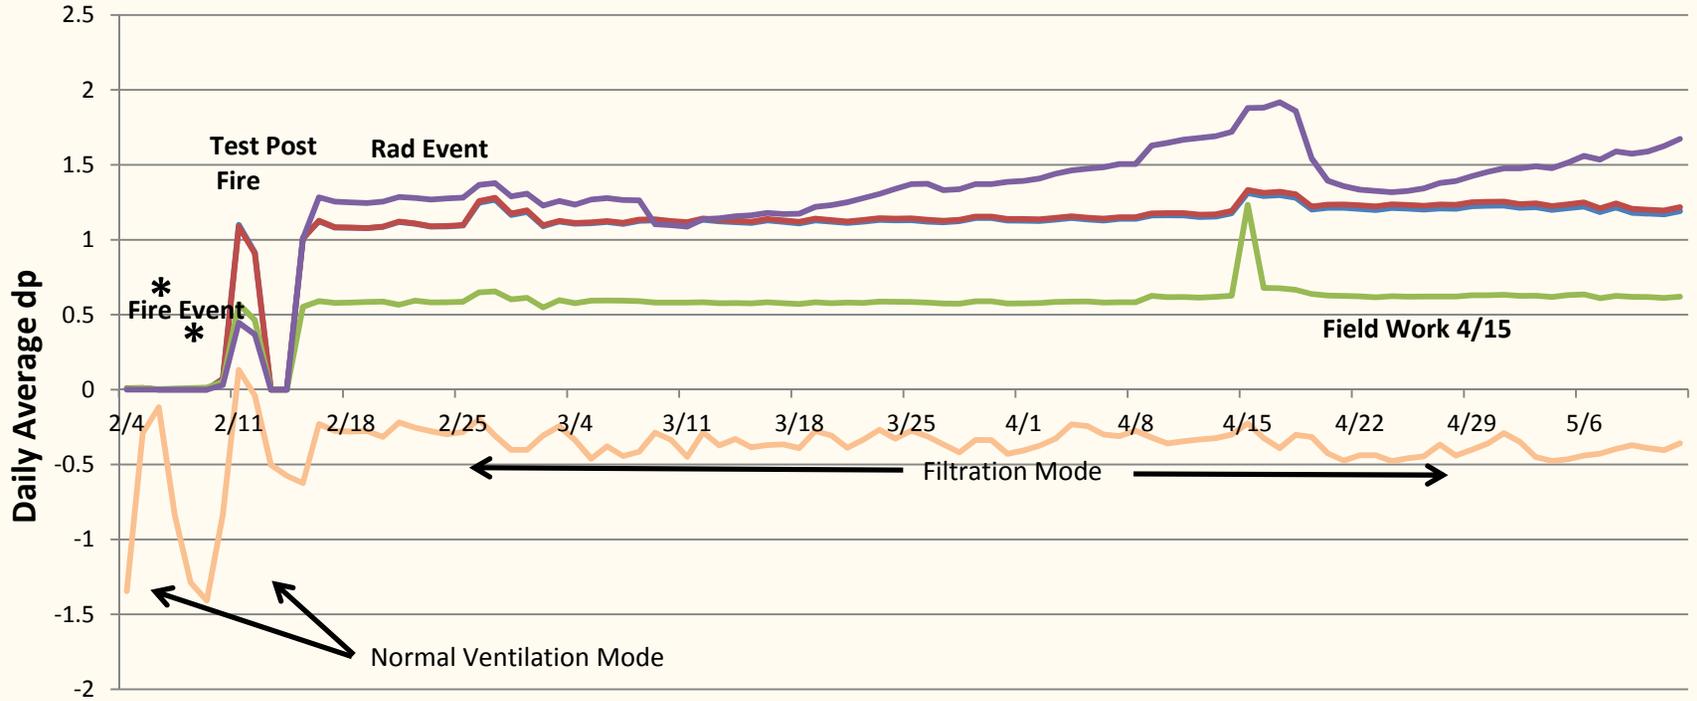

**Prior to 2/5/2014 (2/3 @ 0200-0215)**

857	Mod	0.45
857	High	0.75
857	HEPA	1.52
857	HEPA	1.45

**\* Fire Event Waste Tower dp Details**  
 During the Fire Event positive dp was seen on 2/5 and 2/6. Overall the dp was negative for the daily average.  
 2/5 Postive dp (Avg) + 0.308 (Duration 13 hrs)  
 2/6 Positive dp (AVg) + 0.200 (Duration 14 hrs)

- HEPA
- HEPA
- Hi Particulate
- Mod Filter
- WH Tower