


20.2.300 NMAC Use of Tiers for General Stationary Combustion CO₂ [see modifications to 98.33(b)]

This diagram identifies the *lowest* tier that may be used for a particular fuel. The use of a higher tier is always allowed. See 98.33(b)(6).

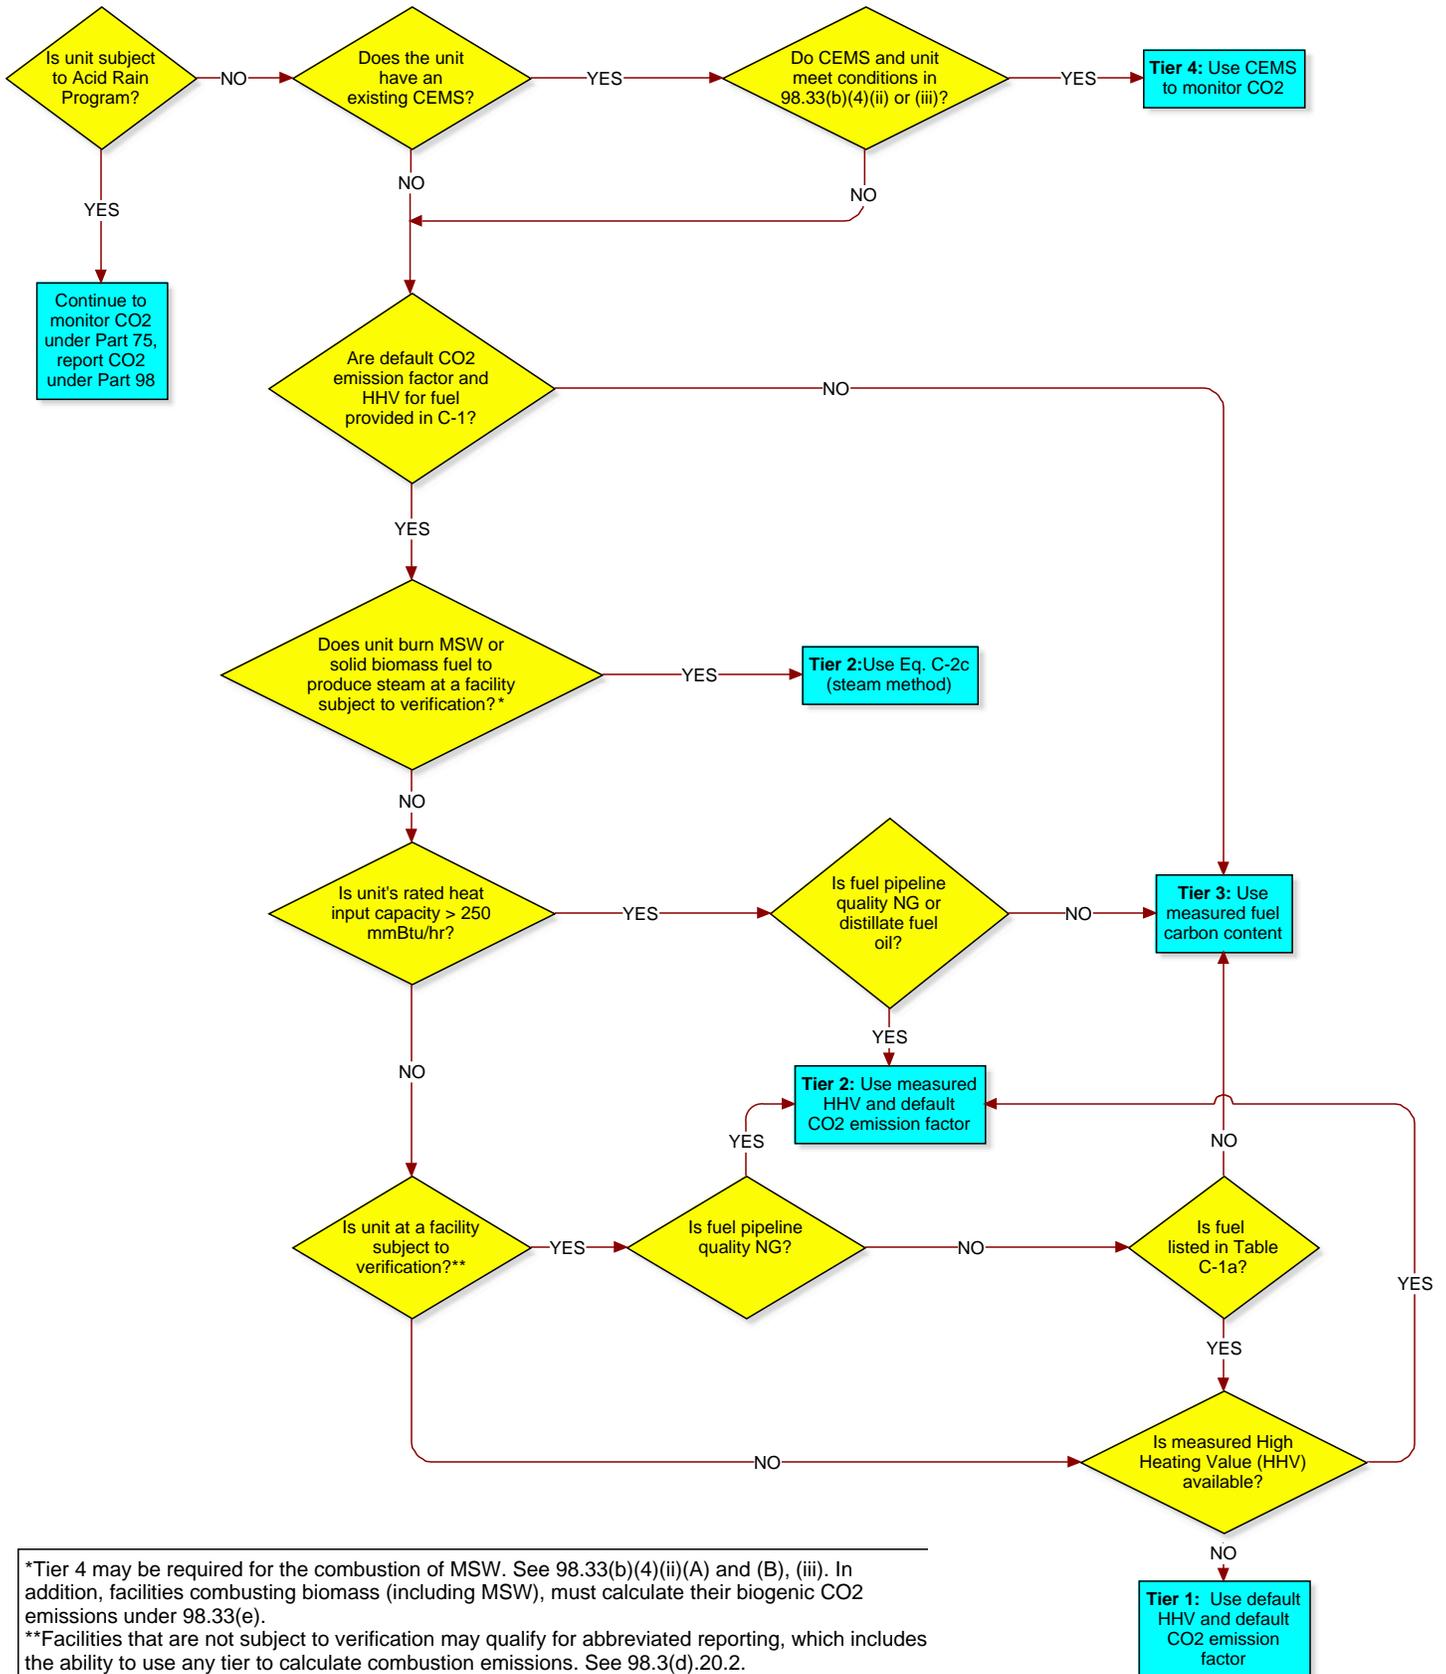

*Tier 4 may be required for the combustion of MSW. See 98.33(b)(4)(ii)(A) and (B), (iii). In addition, facilities combusting biomass (including MSW), must calculate their biogenic CO₂ emissions under 98.33(e).

**Facilities that are not subject to verification may qualify for abbreviated reporting, which includes the ability to use any tier to calculate combustion emissions. See 98.3(d), 20.2.