Fluoride Impacted Public Water Systems

Wells, Springs & Infiltration Galleries*

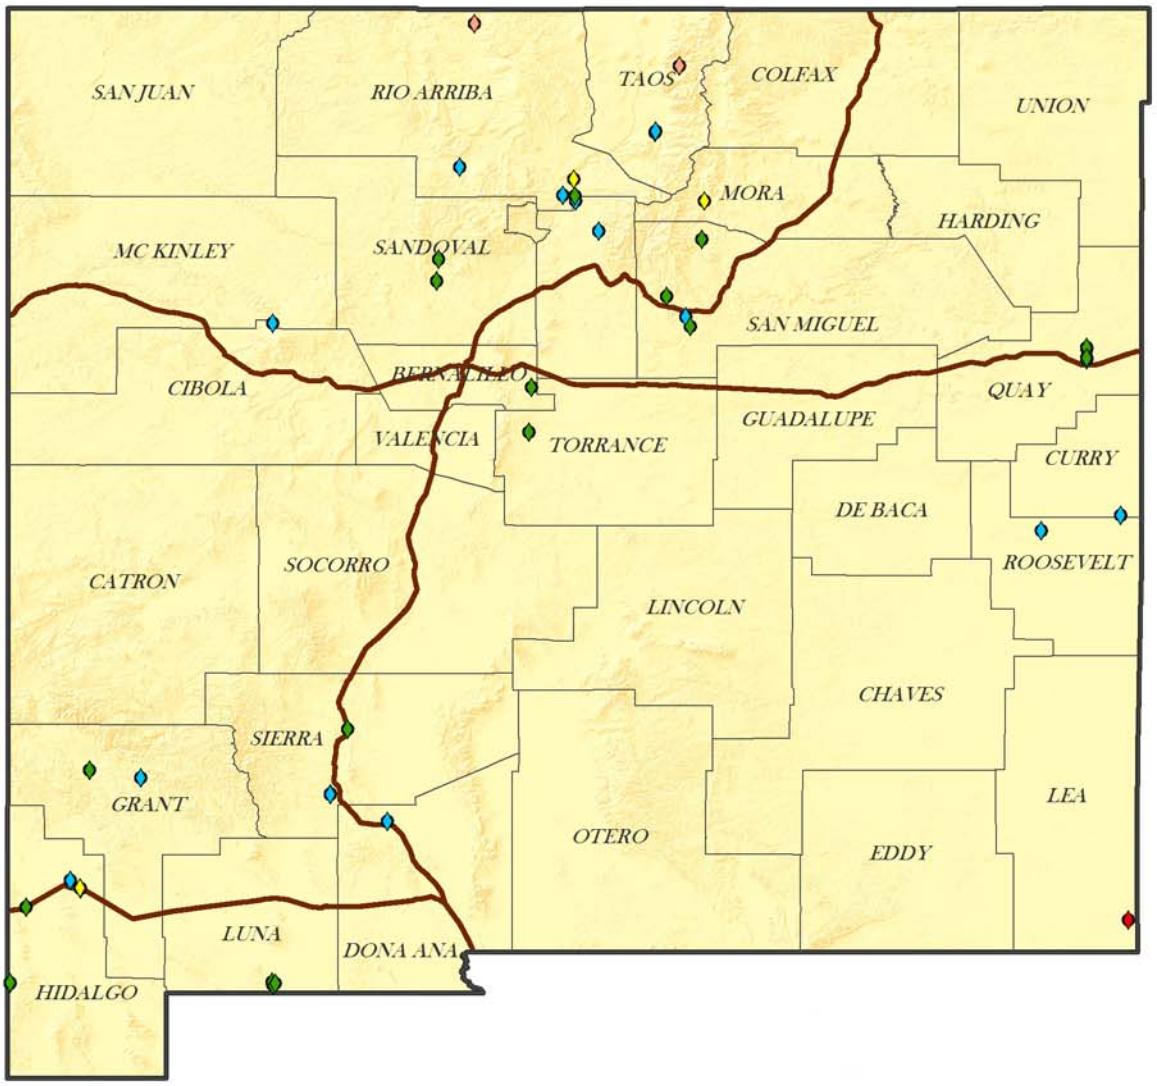

Fluoride Concentration (mg/l)

- 4.0 - 6.0
- 6.1 - 10.0
- 10.1 - 15.0
- 15.1 - 20.0
- 20.1 - 25.0

N

* concentrations are the highest measured from each source

December, 2007